



Exhibit 2. Frequency Distributions of PFOA and PFOS Data from Surface Water-Sourced Community Drinking Water Systems -- August 2020

PFOA by Method 537.1			
Interval (ng/L)	Count	% of Total	Cummulative %
*	17	38.6	38.6
2.1 - 5.0	23	52.3	90.9
5.1 - 10.0	3	6.8	97.7
10.1 - 15.0	1	2.3	100.0
15.0 - 20.0	0	0.0	--
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter


PFOS by Method 537.1			
Interval (ng/L)	Count	% of Total	Cummulative %
*	14	31.8	31.8
2.1 - 5.0	17	38.6	70.5
5.1 - 10.0	11	25.0	95.5
10.1 - 15.0	1	2.3	97.7
15.0 - 20.0	1	2.3	100.0
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter


Σ PFOA + PFOS by Method 537.1			
Interval (ng/L)	Count	% of Total	Cummulative %
*	12	27.3	27.3
2.1 - 5.0	10	22.7	50.0
5.1 - 10.0	14	31.8	81.8
10.1 - 15.0	6	13.6	95.5
15.0 - 20.0	1	2.3	97.7
20.1 - 30.0	1	2.3	100.0
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter


% Distribution of PFOA by Method 537.1

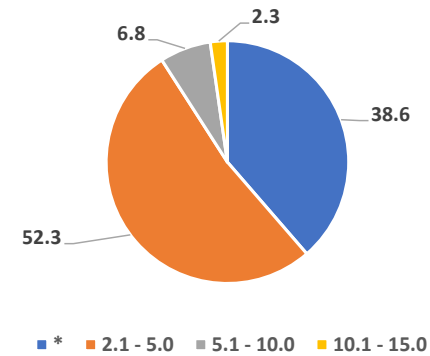

% Distribution of PFOS by Method 537.1

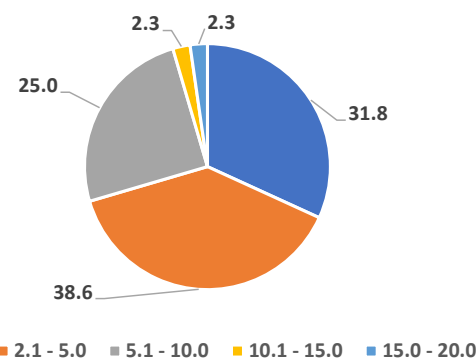

% Distribution of Σ PFOA + PFOS by Method 537.1

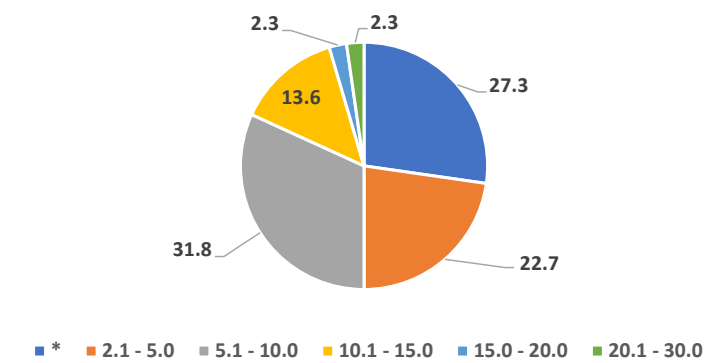

PFOA by Method 533			
Interval (ng/L)	Count	% of Total	Cummulative %
*	13	29.5	29.5
2.1 - 5.0	27	61.4	90.9
5.1 - 10.0	3	6.8	97.7
10.1 - 15.0	1	2.3	100.0
15.0 - 20.0	0	0.0	--
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter


PFOS by Method 533			
Interval (ng/L)	Count	% of Total	Cummulative %
*	10	22.7	22.7
2.1 - 5.0	15	34.1	56.8
5.1 - 10.0	17	38.6	95.5
10.1 - 15.0	1	2.3	97.7
15.0 - 20.0	1	2.3	100.0
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter


Σ PFOA + PFOS by Method 533			
Interval (ng/L)	Count	% of Total	Cummulative %
*	10	22.7	22.7
2.1 - 5.0	5	11.4	34.1
5.1 - 10.0	15	34.1	68.2
10.1 - 15.0	11	25.0	93.2
15.0 - 20.0	1	2.3	95.5
20.1 - 30.0	1	2.3	97.7
30.1 - 40.0	1	2.3	100.0
--	44	100.0	--

-- * = non-detect; ng/L = nanograms per liter

% Distribution of PFOA by Method 533

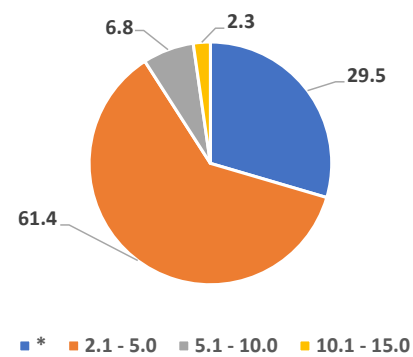

% Distribution of PFOS by Method 533

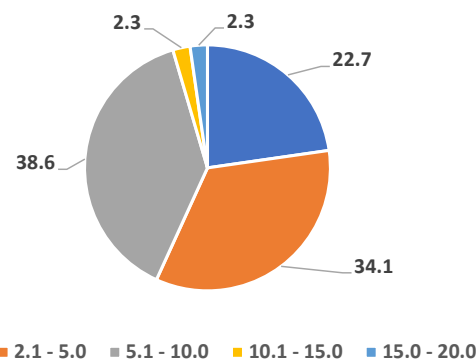

% Distribution of Σ PFOA + PFOS by Method 533

